



**Fire and Emergency Services Committee
Tuesday, September 13, 2016
7:00 p.m.
2502 Country Club Drive, Cameron Park**

Agenda

Members: Chair Director Holly Morrison (HM), Vice Chair Director Scott McNeil (SM)
Alternate Director Amy Blackmon (AB)
Staff: General Manager Mary Cahill, Battalion Chief Bob Counts, Battalion Chief Mike Smith

CALL TO ORDER

ROLL CALL

ADOPTION OF AGENDA

APPROVAL OF CONFORMED AGENDA

OPEN FORUM

At this time, members of the Committee or public may speak on any item not on the agenda that falls within the jurisdiction of this Committee; however, no action may be taken unless the Committee agrees to include the matter on a subsequent agenda.

Principal party on each side of an issue (where applicable) is allocated 10 minutes to speak, individual comments are limited to four minutes and individuals representing a group allocated five minutes. Individuals shall be allowed to speak to an item only once. The Committee reserves the right to waive said rules by a majority vote.

DEPARTMENT MATTERS

PUBLIC COMMENT

Public testimony will be received on each agenda item as it is called. Principal party on each side of an issue (where applicable) is allocated 10 minutes to speak, individual comments are limited to four minutes and individuals representing a group allocated five minutes. Individuals shall be allowed to speak to an item only once. The Committee reserves the right to waive said rules by a majority vote.

1. Updates

- a. Weed Abatement Program – Chief Smith
- b. Ordinance No. 2016.10.19 Adopting the 2016 Edition of the California Fire Code – Chief Smith

2. Items for October Committee Agenda

3. Items to take to the Board of Directors

MATTERS TO AND FROM COMMITTEE MEMBERS

ADJOURNMENT



Fire and Emergency Services Committee
Tuesday, August 9, 2016
7:00 p.m.
2502 Country Club Drive, Cameron Park

DRAFT Conformed Agenda

Members: Chair Director Holly Morrison (HM), Vice Chair Director Scott McNeil (SM)
Alternate Director Amy Blackmon (AB)

Staff: General Manager Mary Cahill, Battalion Chief Bob Counts, Battalion Chief Mike Smith

CALL TO ORDER – 7:00 p.m.

ROLL CALL – HM, SM

ADOPTION OF AGENDA - Adopted

APPROVAL OF CONFORMED AGENDA - Approved

OPEN FORUM

At this time, members of the Committee or public may speak on any item not on the agenda that falls within the jurisdiction of this Committee; however, no action may be taken unless the Committee agrees to include the matter on a subsequent agenda.

Principal party on each side of an issue (where applicable) is allocated 10 minutes to speak, individual comments are limited to four minutes and individuals representing a group allocated five minutes. Individuals shall be allowed to speak to an item only once. The Committee reserves the right to waive said rules by a majority vote.

DEPARTMENT MATTERS

PUBLIC COMMENT

Public testimony will be received on each agenda item as it is called. Principal party on each side of an issue (where applicable) is allocated 10 minutes to speak, individual comments are limited to four minutes and individuals representing a group allocated five minutes. Individuals shall be allowed to speak to an item only once. The Committee reserves the right to waive said rules by a majority vote.

1. Updates

- a. Weed Abatement Program – Chief Smith
 - o Attachment A – August Fire Committee Update
 - o Attachment B – Weed Abatement Inspection Spreadsheet
 - o Attachment C – Weed Abatement Call Log
 - o Attachment D – Weed Abatement Complaint Form
 - o Attachment E – Weed Abatement Inspection Form
 - o Attachment F – Ordinance No. 2013.12.18
- b. New Engine Final Report – Chief Counts
 - o Attachment G

2. Items for September Committee Agenda

- *Weed Abatement Update*
- *Ordinance No. 2013.12.18 Update*
- *Schedule of when Engine is Hired out*

3. Items to take to the Board of Directors

- *Schedule of when Engine is Hired out*
- *September agenda - Ordinance No. 2013.12.18 Fire Code*

MATTERS TO AND FROM COMMITTEE MEMBERS

ADJOURNMENT – 7:37 p.m.

Cameron Park Fire Department

In Cooperation with

CAL FIRE



3200 COUNTRY CLUB DRIVE
CAMERON PARK, CA 95682
Weed Abatement (530)-672-7358
Business (530) 677-6190

September Meeting Update:

Weed Abatement:

The Weed Abatement Specialist is continuing to work on updating the existing individual file information we have, comparing Vacant Lot database received from El Dorado County to the files we currently have, creating new folders for each vacant lot, updating the Weed Abatement Spreadsheet to reflect current status on each lot also eliminating archived lots from spreadsheet and creating a file for the archived properties.

We have been working on the new 'Weed Abatement Letterhead' and have come up with a design after final review/approval. Also have been working on the 'Vendor Information' sheet to send out to proposed vendors with instructions on what we require from them to be placed on our in-house vendor list. The Vendor List will be on file for us to refer to if/when we have to move forward with clearing properties that are non-compliant.

Have only received 5 phone calls this month. Inspected properties on Garden Circle, property by Cameron Park Airport/Cameron Park Drive, and again on Mira Loma. Also walk in from property owner on Knollwood/Kimberly wanting to know clearance requirements and local vendors. Spent quite a bit of time with her answering questions and going over the requirements. Another walk in complaint regarding a vacant lot on Raben Way. Inspected property, lot is very overgrown. Follow-up contacting property owners.

2016 California Fire Code Draft Update:

All Fire Prevention Officers (FPO's) in El Dorado County as a group have completed the Fire Code review and creation of the new county fire code ordinance amendments for all fire districts in El Dorado County to use. This will coincide with the new 2016 California Fire Code which the State Fire Marshal Office will adopt at the end of this year. Resolution 2016-14 "Adopting Findings Supporting Amendments To The Fire Code" was adopted at CPCSD August Board Meeting. Ordinance No. 2016.10.19 will be presented for" ADOPTING THE 2016 EDITION OF THE CALIFORNIA FIRE CODE, BASED UPON THE 2015 EDITION OF THE INTERNATIONAL FIRE CODE, REGULATING AND GOVERNING THE SAFEGUARDING OF LIFE AND PROPERTY FROM FIRE AND EXPLOSION HAZARDS ARISING FROM THE STORAGE, HANDLING AND USE OF HAZARDOUS SUBSTANCES, MATERIALS AND DEVICES, AND FROM CONDITIONS HAZARDOUS TO LIFE OR PROPERTY IN THE OCCUPANCY OF BUILDINGS AND PREMISES IN THE Cameron Park Community Service District Fire Department".



U.S. Department of the Interior
Bureau of Land Management

News Release

Central California District

Central California District, 2800 Cottage Way, Sacramento, CA 95825

For Immediate Release: Aug. 24, 2016

CC-16-49

Contact: David Christy, (916) 941-3146, dchristy@blm.gov

BLM Fuel Break Helps Save Homes in Cameron Park

EL DORADO HILLS, Calif. – A review of fire behavior has concluded the Bureau of Land Management’s fuels management program helped firefighters contain a fire that threatened homes in Cameron Park.

The BLM Mother Lode Field Office attributes the small size of the Aug. 15 Park Wildfire off Meder Road to the quick response of CAL FIRE and a fuels management program that established a 100-foot-wide fuel break two years ago.

The fire burned in the tranquil 4,790-acre Pine Hills Preserve. Hundreds of homes encircle this preserve to be close to nature. When natural areas become overgrown, a purging wildfire is natural and inevitable. The fire was human caused and exact cause is under investigation.

“Understanding the wildfire risk, the Mother Lode Field Office established a rotating fuels management program over a decade ago to improve ecosystem health and reduce the wildfire risk to the Cameron Park community,” said Bill Haigh, Mother Lode field manager.

“The Park Wildfire was the fourth wildfire on BLM-managed public land this summer,” said Jerry Martinez, BLM zone fire management officer. “Three out of the four wildfires tested our fuelbreaks. Firefighters reported that in the unmanaged land, fire intensity escalated due to continuous vegetation (fuels) with above-average heights. Once the wildfire reached the fuel break, fire activity slowed due to the lower fuel height and sporadic combustible fuels. With the height and depth of the fuel reduced, firefighters were able to easily access the Park Wildfire and quickly extinguish the heat source.”

For example, a 10-foot-tall unmanaged chaparral can produce flame lengths 15-20 feet tall. Firefighters reported flame lengths dropped to three-to-five-foot-tall once the fire reached the fuel break with two-foot-tall chaparral.

Fifty-six acres have been treated inside the 454-acre Cameron Park Unit on a two-to-three year rotation, with 4.2 miles of fuel breaks around the perimeter of BLM land that borders private property (up to 100 feet wide). [Fuels management](#) includes a combination of hand clearing and mechanical chipping of highly flammable vegetation (fuels) in addition to piling the dead vegetation and burning it on site.

One of the challenges facing land management agencies is maintaining the effectiveness of fuel breaks, Martinez said. “We have to keep cutting brush just like you mow your lawn,” he said. In just a few years, the brush can grow back to the point the fuel break is ineffective, so the BLM must regularly cut brush on existing fuel breaks.

“The Bureau of Land Management would like to share its success story as a lesson to all residents that live near nature,” Haigh said. A 100-foot minimum fuel break provides space for fighters to suppress an encroaching fire and make heat convection less likely to ignite a house or fence.

Find out what the experts know about the best way to make your home and neighborhood safer from wildfire. The Bureau of Land Management can provide you wildfire tips from the basics of defensible [space](#) and [sound landscaping techniques](#) to research on [how homes ignite](#).

The [Pine Hills Preserve](#) is a cooperative conservation effort among local entities to protect the habitat of eight rare plant species. The preserve lands and the adjacent Kanaka Valley, located approximately 30 miles east of Sacramento, includes 4,790 acres, about 70 percent of which has a dense cluster of rare plants and is within an area designated for the recovery of five federally listed rare plants.

Visit BLM California on [Facebook](#) to see fuels management photos. For more information, contact the Mother Lode Field Office at (916) 941-3101.

--BLM--

OVERVIEW OF THE PROPOSED FIRE CODE ORDINANCE




Presentation designed for the
Cameron Park Community Service District
By Michael Smith

FIRE CODE ORDINANCE PROCESS

- Fire Department drafts a new ordinance
- Fire Chief/leadership team approve ordinance language
- Public is notified at least 30 days prior to the public hearing
 - 2 notices over two weeks at least five days apart
 - Mountain Democrat



WHY WE ARE DOING THIS

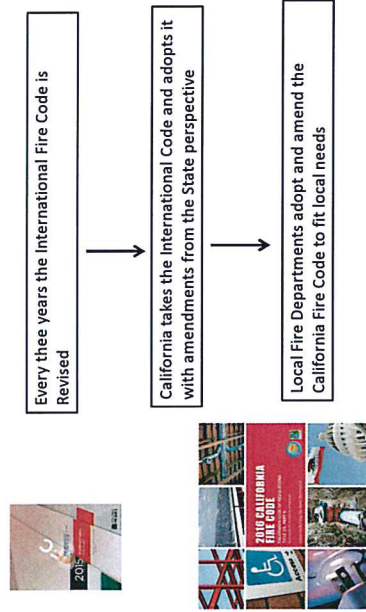

FIRE CODE ORDINANCE PROCESS

- Local Fire Board holds two public hearings on the topic
- At the second public hearing, the Local Fire Board adopts the ordinance
- Non-building standards - are sent directly to the Department of Housing and Community Development and the California Building Standards Commission
- Building standards - are sent to the Board of Supervisors for Resolution and adoption
- They too are then filed with the Department of Housing and Community Development and the California Building Standards Commission

PARTICIPANTS IN DEVELOPMENT

- El Dorado County Fire Prevention Officer's Association worked collectively to develop this draft ordinance
- The proposed ordinance is consistent with every West Slope Fire Department in the County
- The building department and officials, CEDAC, and County Counsel are all involved so we are all in agreement with the draft ordinance

RESOLUTION 2016.14

- Climate, geography and topographic conditions found in the local area have a dramatic effect on the frequency, spread, acceleration and intensity of fire behavior.
- Our Ordinance will cite this Resolution as the justification for adoption and amendment of the fire code

RESOLUTION 2016.14

- A Resolution is needed to justify the need for local fire code amendments based on:
 - CLIMATE (local climatic conditions affect the acceleration, intensity and size of fire)
 - Precipitation
 - Relative Humidity
 - Temperatures
 - Winds
 - GEOGRAPHIC AND TOPOGRAPHIC issues
 - Size and population
 - Topography
 - Roads and streets

ORDINANCE # 2016.10.19

- **Section 1: FINDINGS :**
 - Adopting the California Fire Code as amended and,
 - Specific sections of the International Fire Code not adopted by California,
 - Such changes are necessary because of local climatic, geological and/or topographic conditions,
 - To address the fire problems, concerns and future direction by which the District can establish and maintain an environment that will afford an acceptable level of fire and life safety to all who live and work within our community

ORDINANCE # 2016.10.19

- **Section 2: ADOPTION OF CODE:**
 - Adopting the 2016 California Fire Code
 - Adopting International Fire Code sections not adopted by California
 - Adopting local amendments to the codes to fit local needs

SIGNIFICANT CHANGES

- Significant changes from Ordinance 2013.12.18 to new Ordinance # 2016.10.19
- Renumbering
 - California Fire Code moved certain sections of the code around... we are renumbering to match
- Section 503 – Fire Apparatus Access Roads
 - Not adopted by California
 - Critical issue for El Dorado Co. growth
 - Often contentious issue for developers
 - We are simply adopting what we adopted last time, 15' vertical clearances, 20' wide roads (now corresponding with Title 14)

ORDINANCE # 2016.10.19

- **SECTION 3: CALIFORNIA FIRE CODE, AMENDMENTS:**
 - This section contains the details on what exact sections are being adopted, amended and/or added
 - This is the meat of the document

SIGNIFICANT CHANGES

- Appendix D – Fire Apparatus Access Roads
 - Adopted and “rolled” into Chapter 5 of our Ordinance
 - Remoteness clause
 - Helps with Circulation and response times in new subdivisions
- Aerial Fire Apparatus Access
 - Several Departments need this language that pertains to aerial fire apparatus

SIGNIFICANT CHANGES

- Section 907.2.d – Installation of Type I Hoods
 - Requirement of Type I Hoods to be connected to a Fire Alarm if installed or replaced
 - Improves the response times to fire where these hoods exist
 - Provides proper notification of these types of kitchen fires
- Section 6113.2 – Underground LPG Tank Ownership
 - Prevents underground tanks from being sold to end users who do not maintain them
 - Puts the ownership on the leasing company to properly inspect them annually and to provide that info to the Fire Department.

QUESTIONS?



SIGNIFICANT CHANGES

- Appendix B – Fire Flow Requirements
 - Tables change their look
 - The info is the same
 - Minimum fire flow rate for subdivisions with homes over 3,600 square feet is 1,500 GPM minimum.
 - This is in better alignment with operations
 - The county fire districts are now using the same GPM

ORDINANCE No. 2016.10.19

AN ORDINANCE OF the Cameron Park Community Services District Fire Department
“CALIFORNIA FIRE CODE” WITHIN Cameron Park Community Service District Fire Department

BE IT ORDAINED BY THE BOARD OF DIRECTORS OF the Cameron Park Community Service District Fire Department. Also known as the Cameron Park Community Service District Fire Department as FOLLOWS:

AN ORDINANCE OF THE Cameron Park Community Service District Fire Department ADOPTING THE 2016 EDITION OF THE CALIFORNIA FIRE CODE, BASED UPON THE 2015 EDITION OF THE INTERNATIONAL FIRE CODE, REGULATING AND GOVERNING THE SAFEGUARDING OF LIFE AND PROPERTY FROM FIRE AND EXPLOSION HAZARDS ARISING FROM THE STORAGE, HANDLING AND USE OF HAZARDOUS SUBSTANCES, MATERIALS AND DEVICES, AND FROM CONDITIONS HAZARDOUS TO LIFE OR PROPERTY IN THE OCCUPANCY OF BUILDINGS AND PREMISES IN THE Cameron Park Community Service District Fire Department; PROVIDING FOR THE ISSUANCE OF PERMITS AND COLLECTION OF FEES THEREFORE; REPEALING ORDINANCE NO. 2013.12.18 OF THE Cameron Park Community Service District Fire Department AND ALL OTHER ORDINANCES AND PARTS OF THE ORDINANCES IN CONFLICT THEREWITH.

Be it ordained by the Board of Directors of the Cameron Park Community Service District Fire Department, also known as the Cameron Park Community Service District Fire Department:

- Section 1: **FINDINGS:**
- Section 2: **ADOPTION OF CODE:**
- Section 3: **CALIFORNIA FIRE CODE, AMENDMENTS:**
- Section 4: **ESTABLISHING LIMITS:**
- Section 5: **CONFLICT:**
- Section 6: **SEVERABILITY:**
- Section 7: **EFFECTIVE DATE AND PUBLICATION:**

SECTION 1: FINDINGS:

The Cameron Park Community Service District Fire Department makes certain changes (listed below) to the California Fire Code, 2016 Edition, pursuant to Health and Safety Code Section 13869.7, 17958.7 and 18941.5 during this code adoption process. Such changes are necessary because of local climatic, geological and/or topographic conditions, as specified by the Matrix attached at the end of this ordinance. The Cameron Park Community Service District Fire Department has adopted, pursuant to Section 18941.5 of the California Health and Safety Code, the findings of facts relative to these conditions by Resolution #2016-14 of the Cameron Park Community Service District Fire Department dated August 17, 2016.

These changes include amendments and additions to the California Fire Code in the following sections: 111.4, 503.2, 503.2.1, 503.2.5, 503.2.6, 503.4.2 thru 503.4.5, 507.5.1, 604.1.2, 903.2, 903.2.a, 903.2.b, 903.2.1, 903.2.C, 903.2.3, 903.2.4, 903.2.7, 903.2.9, 903.2.10, 907.2.a, 907.2.b, 907.2.c, 907.2.d, 5601.2, Table 6104.3 Footnote "d", 6112.1, 6112.2, 6112.3, 6113.1, 6113.2, Appendix B105.1, Table B105.1(1), B105.2, & Table B105.2. These changes are itemized in SECTION 2: ADOPTION OF CODE of this ordinance.

These changes also include the following CA Fire Code Sections and Appendices not adopted by the California State Fire Marshal; 101.1 thru 101.5, 102.6 thru 102.8, 102.10 thru 102.12, 103.1 thru 104.1, 104.3 thru 104.4, 104.6 thru 104.6.4, 104.8, thru 104.9.2, 104.10.1 thru 104.11.3, 105.2.3, 105.3.1 thru 105.3.2, 105.6.10, 105.6.17 thru 105.6.19, 105.6.28, 105.6.29 thru 105.6.37, 105.6.39 thru 105.6.44 105.7.17 thru 105.7.18, 106.1, 107.1 thru 108.3, 109.3.2 thru 109.4.1, 112.1, 113.1 thru 113.5, 113.6, 113.6.1, 302, 303.1 thru 303.9, 305.1 thru 305.5, 307.1, thru 307.5, 308.1 thru 308.4.1, 403.1, 403.5 thru 403.12, 503, Appendix D104.1 thru D104.3, D105.1 thru D105.4, D106.1, D107.1, D107.2, Appendix F and N, based on the 2015 edition of the International Fire Code as published by the International Code Council.

SECTION 2: ADOPTION OF CODE:

That a certain document, three (3) copies of which are on file in the office of the Secretary of the Board of Directors of the Cameron Park Community Service District Fire Department, being marked and designated as the California Fire Code, 2016 edition, in its entirety, with the following amendments: 111.4, 503.2, 503.2.1, 503.2.5, 503.2.6, 503.4.2 thru 503.4.5, 507.5.1, 604.1.2, 903.2, 903.2.a, 903.2.b, 903.2.1, 903.2.C, 903.2.3, 903.2.4, 903.2.7, 903.2.9, 903.2.10, 907.2.a, 907.2.b, 907.2.c, 907.2.d, 5601.2, Table 6104.3 Footnote "d", 6112.1, 6112.2, 6112.3, 6113.1, 6113.2, Appendix B105.1, Table B105.1(1), B105.2, & Table 105.2; and the following CA Fire Code Sections and Appendices not adopted by the California State Fire Marshal: 101.1 thru 101.5, 102.6 thru 102.8, 102.10 thru 102.12, 103.1 thru 104.1, 104.3 thru 104.4, 104.6 thru 104.6.4, 104.8, thru 104.9.2, 104.10.1 thru 104.11.3, 105.2.3, 105.3.1 thru 105.3.2, 105.6.10, 105.6.17 thru 105.6.19, 105.6.28, 105.6.29 thru 105.6.37, 105.6.39 thru 105.6.44 105.7.17 thru 105.7.18, 106.1, 107.1 thru 108.3, 109.3.2 thru 109.4.1, 112.1, 113.1 thru 113.5, 113.6, 113.6.1, 302, 303.1-303.9, 305.1-305.5, 307.1, thru 307.5, 308.1 thru 308.4.1, 403.1, 403.5 thru 403.12, 503, Appendix D104.1 thru D104.3, D105.1 thru D105.4, D106.1, D107.1, D107.2, Appendix F and N, based on the 2015 edition of the International Fire Code as published by the International Code Council and the 2016 California Fire Code, be and is hereby adopted as the Fire Code of the Cameron Park Community Service District Fire Department, in the State of California regulating and governing the safeguarding of life and property from fire and explosion hazards arising from the storage, handling and use of hazardous substances, materials and devices, and from conditions hazardous to life or property in the occupancy of buildings and premises as herein provided; providing for the issuance of permits and collection of fees therefore; and each and all of the regulations, provisions, penalties, conditions and terms of said Fire Code on file in the office of the Cameron Park Community Service District Fire Department are hereby referred to, adopted, and made a part hereof, as if fully set out in this ordinance, with the additions, insertions, deletions and changes, if any, prescribed in Section 3 of this ordinance.

SECTION 3: CALIFORNIA FIRE CODE, AMENDMENTS:

The following Sections are hereby amended or added:

California Fire Code, Chapter 1 Amendments – Scope and Administration:

Section 105 - Permits

Section 105.6.28 of Chapter 1 of the Fire Code of the Cameron Park Community Service District Fire Department is amended to read as follows:

105.6.28 - LP Gas. An operational permit is required for:

1. Storage and use of LP-gas.

Exception: A permit is not required for individual containers with ~~500~~ 100-gallon water capacity or less or multiple container systems having an aggregate quantity not exceeding ~~500~~ 251 gallons serving occupancies in Group R-3.

Section 109 - Violations

Section 109.4 of Chapter 1 of the Fire Code of the Cameron Park Community Service District Fire Department is amended to read as follows:

Section 109.4 Violation penalties. Persons who shall violate a provision of this code or shall fail to comply with any of the requirements thereof or who shall erect, install, alter, repair or do work in violation of the approved construction documents or directive of the fire code official, or of a permit or certificate used under provisions of this code, shall be guilty of a misdemeanor, punishable by a fine of not more than \$1000.00 and/or by imprisonment not exceeding 6 months, or both such fine and imprisonment. Each day that a violation continues after due notice has been served shall be deemed a separate offense. (Health & Safety Code Section 13145 and 17995).

Section 111 - Stop Work Order

Section 111.4 of Chapter 1 of the Fire Code of the Cameron Park Community Service District Fire Department is amended to read as follows:

111.4. Failure to comply. Any person who shall continue any work after having been served with a stop work order, except such work as that person is directed to perform to remove a violation or unsafe condition, shall be liable to a fine of not less than \$500 or not more than \$1,000. (Health & Safety Code Section 13145 and 17995).

Section 113 – Fees

Sections 113.6 and 113.6.1 of Chapter 1 of the Fire Code of the Cameron Park Community Service District Fire Department are added to read as follows:

113.6 Permit, Plan Review and Inspection Fees. A schedule of fees adopted by the Fire District Board of Directors for Plan Review, Inspections and the issuance of Permits by the Fire District may be found in the most current Cameron Park Community Service District Fire Department fee schedule (Health & Safety Code 17951).

113.6.1 Cost Recovery Fees. Fire service fees may be charged to any person, firm, corporation or business that through negligence, violation of the law, or as a result of carelessness, is responsible for the cause of the Fire District to respond to the scene of an incident. A district board may charge a fee to cover the cost of any service which the district provides or the cost of enforcing any regulation for which the fee is charged. (Health and

Safety Code 13916). The fee shall not exceed the actual cost of suppressing the fire and/or responding to the scene of an incident.

California Fire Code, Chapter 5 Amendments – Fire Service Features

Section 503 - Fire Apparatus Access Roads

Section 503 of the CA Fire Code is **adopted in its entirety** as part of the Fire Code of the Cameron Park Community Service District Fire Department. Only the additions or amendments to Section 503 are listed below:

503.2 Specifications. All fire apparatus access roads shall be installed and arranged in accordance with Sections 503.2.1 through 503.2.8.

[California Code of Regulations, Title 19, Division 1, §3.05(a)] Fire Department Access and Egress. (Roads)

(a) Roads. Required access roads from every building to a public street shall be all-weather hard-surfaced (suitable for use by fire apparatus) right-of-way not less than 20 feet (6096 mm) in width. Such right-of-way shall be unobstructed and maintained only as access to the public street.

Exception: The enforcing agency may waive or modify this requirement if in his opinion such all-weather hard surfaced condition is not necessary in the interest of public safety and welfare.

503.2.1 Dimensions. For one and two family dwelling units (R3) applications, fire apparatus access roads shall have an unobstructed width of not less than 20 feet plus one-foot shoulder on each side, except for *approved* security gates in accordance with Section 503.6, and an unobstructed vertical clearance of not less than 15 feet.

For applications other than (R3), fire apparatus access roads shall have an unobstructed width of not less than 20 feet, plus one-foot shoulder on each side, except for *approved* security gates in accordance with Section 503.6, and an unobstructed vertical clearance of not less than 15 feet or as approved by the fire code official.

All Driveways, as defined by Title 14 SRA Fire Safe Regulations, shall be not less than 12 feet wide.

503.2.5 Dead ends. For one and two family dwelling units (R3) applications, dead-end fire apparatus access roads shall comply with Title 14 SRA Fire Safe Regulations and shall have a turnaround constructed at its terminus.

For applications other than (R3), dead-end fire apparatus access roads in excess of 150 feet (45 720 mm) in length shall be provided with an *approved* area for turning around fire apparatus.

503.2.6 Bridges and elevated surfaces. Where a bridge or an elevated surface is part of a fire apparatus access road, the bridge shall be constructed and maintained in accordance with the current El Dorado County Transportation Division bridge standard. Bridges and

elevated surfaces shall be designed for a live load sufficient to carry the imposed loads of fire apparatus. Vehicle load limits shall be posted at both entrances to bridges when required by the *fire code official*. Where elevated surfaces designed for emergency vehicle use are adjacent to surfaces which are not designed for such use, *approved* barriers, *approved* signs or both shall be installed and maintained when required by the *fire code official*.

503.4.2 Fire Apparatus Access Gates. Fire Apparatus Access Road Gates shall meet the standards identified in the Fire Department's Gate Standard.

Section 503.4.3 of the Fire Code of the Cameron Park Community Service District Fire Department is added to read as follows:

503.4.3 Roads from 20 to 29 feet in width. Fire apparatus access roads, 20 to 29 feet wide, shall be posted on both sides as a fire lane, with no parking allowed on either side of the roadway.

Section 503.4.4 of the Fire Code of the Cameron Park Community Service District Fire Department is added to read as follows:

503.4.4 Roads from 30 to 35 feet in width. Fire apparatus access roads, 30 to 35 feet wide, shall be posted on one side as No Parking, Fire Lane, with parking allowed only on the opposite side of the roadway.

Section 503.4.5 of the Fire Code of the Cameron Park Community Service District Fire Department is added to read as follows:

503.4.5 Roads 36 feet and greater in width. Fire apparatus access roads, 36 feet and greater in width, may allow parking on both sides of the roadway.

The Following Sections of the California Fire Code, Appendix D – Fire Apparatus Access Roads are adopted and amended to read as part of Chapter 5 as follows:

Section D104 - Commercial and Industrial Developments

D104.1 Buildings exceeding three stories or 30 feet in height. Buildings or facilities exceeding 30 feet or three stories in height shall have at least two means of fire apparatus access for each structure.

D104.2 Buildings exceeding 62,000 square feet in area. Buildings or facilities having a gross *building area* of more than 62,000 square feet shall be provided with two separate and *approved* fire apparatus access roads.

D104.3 Remoteness. Where two access roads are required, they shall be placed a distance apart equal to not less than one half of the length of the maximum overall diagonal dimension of the property or area to be served, measured in a straight line between accesses.

Exception: Fire apparatus roads cannot be installed because of location on property, topography, waterways, nonnegotiable grades or similar condition, and an approved alternative means of fire protection is provided.

Section D105 - Aerial Fire Apparatus Access Roads

D105.1 Where required. Buildings or portions of buildings or facilities exceeding 30 feet in height above the lowest level of fire department vehicle access shall be provided with *approved* fire apparatus access roads capable of accommodating fire department aerial apparatus. Overhead utility and power lines shall not be located within the aerial fire apparatus access roadway.

D105.2 Width. Aerial fire apparatus access roads shall have a minimum unobstructed width of 26 feet, exclusive of shoulders, in the immediate vicinity of any building or portion of building more than 30 feet in height.

D105.3 Proximity to building. At least one of the required access routes meeting this condition shall be located within a minimum of 15 feet and a maximum of 30 feet from the building, and shall be positioned parallel to one entire side of the building.

D105.4 Obstructions. Overhead utility and power lines shall not be located over the aerial fire apparatus access road or between the aerial fire apparatus road and the building. Other obstructions shall be permitted to be placed with the approval of the fire code official.

Section D106 - Multiple-Family Residential Developments

D106.1 Projects having more than 100 dwelling units. Multiple- family residential projects having more than 100 *dwelling units* shall be equipped throughout with two separate and *approved* fire apparatus access roads.

Section D107 - One- or Two-Family Residential Developments

D107.1 One- or two-family dwelling residential developments. Developments of one- or two-family *dwelling*s shall be provided with separate and *approved* fire apparatus access roads and shall meet the requirements of **D107.2 Remoteness**, when required by the Fire Chief.

Section 507 – Fire Protection Water Supplies

Sections 507.5.1 of Chapter 5 of the Fire Code of the Cameron Park Community Service District Fire Department are amended to read as follows:

Section 507.5.1 Where required. Where a portion of the facility or building hereafter constructed or moved into or within the jurisdiction is more the 400 150 feet from a hydrant on a fire apparatus access road, as measured by an approved route around the exterior of the facility or building, on-site fire hydrants and mains shall be provided where required by the fire code official.

Exception: For Group R-3 and Group U occupancies, *equipped throughout with an approved automatic sprinkler system installed in accordance with Section 903.1*, the distance requirement shall be not more than 600 feet (183m).

California Fire Code, Chapter 6 Amendments – Building Services and System

Section 604 - Emergency and Standby Power Systems

Sections 604.1.2 of Chapter 6 of the Fire Code of the Cameron Park Community Service District Fire Department are amended to read as follows:

Section 604.1.2 Installations. Emergency power systems and standby power systems shall be installed in accordance with this code, NFPA 110 and NFPA 111. All buildings, other than one- and two-family dwelling units, and agricultural buildings not used for commercial purpose, with standby power shall have a shunt trip device that disconnects all power sources to the building, approved by the Fire Code Official. Existing installations shall be maintained in accordance with the original approval.

California Fire Code, Chapter 9 Amendments – Fire Protection Systems

Section 903 -Automatic Sprinkler Systems

Section 903.2 of Chapter 9 of the Fire Code of the Cameron Park Community Service District Fire Department is amended to read as follows:

903.2 Where required. Approved, NFPA 13 automatic sprinkler system shall be required and installed in all buildings or structures, greater than 3600 square feet, when constructed or relocated within the jurisdiction.

Exceptions:

1. One- and two-family dwelling units (R-3 Occupancies). (See Section R313 of the 2016 CA Residential Code that requires all one and two family dwellings to be equipped with an NFPA 13D sprinkler system)
2. Agricultural buildings, except any agricultural building which is used for commercial purposes (e.g. retails sales, food service, and/or special events)

Sections 903.2.a and 903.2.b of Chapter 9 of the Fire Code of the Cameron Park Community Service District Fire Department are added to read as follows:

903.2.a Status of existing buildings greater than 3,600 square feet. In existing buildings 3600 square feet or greater, other than one- and two-family dwelling units, and agricultural buildings not under Special Use Permit for commercial purposes, where the floor area of the building or structure is increased by an addition of more than thirty percent (30%) or 1,000 square feet, whichever is less, such building or structure shall be made to conform to Section 903.2.

903.2.b Status of existing buildings less than 3,600 square feet. In existing buildings 3,600 square feet or less, other than one-and two-family dwelling units, and agricultural buildings not under Special Use Permit for commercial purposes, where the floor area of the building or structure is increased to a total square footage over 3,600 square feet, by an addition of more than thirty percent (30%) or 1,000 square feet, whichever is less, such building or structure shall be made to conform to Section 903.2.

The following sections are amended by changing California Fire Code requirements to 3,600 square feet for fire sprinkler installation, as follows (the complete text of the section is not provided):

903.2.1	Group A	<u>All Group A</u> - 3,600 square feet or greater
903.2.c	Group B	<u>All Group B</u> - 3,600 square feet or greater
903.2.3	Group E	<u>All Group E</u> - 3,600 square feet or greater
903.2.4	Group F	<u>All Group F</u> - 3,600 square feet or greater *2,500 square feet or greater for manufacturing of mattresses and upholstered furniture
903.2.7	Group M	<u>All Group M</u> - 3,600 square feet or greater
903.2.9	Group S-1	<u>All Group S-1</u> - 3,600 square feet or greater *2,500 square feet for storage of mattresses and upholstered furniture
903.2.10	Group S-2	<u>All group S-2</u> - 3,600 square feet or greater

Section 907 – Fire Alarm and Detection Systems

Sections 907.2.a, 907.2.b and 907.2.c, 907.2.d of Chapter 9 of the Fire Code of the Cameron Park Community Service District Fire Department are added to read as follows:

907.2.a An approved fire alarm/detection system shall be installed in all buildings with a floor area less than 3,600 square feet.

Exceptions:

1. One and two family dwellings (R-3 Occupancies and other occupancies classified as “U”).
2. Agricultural buildings, except any agricultural building which is used for commercial purposes (e.g. retails sales, food service, and/or special events).
3. Buildings with a floor area less than 500 square feet may be exempt, as determined by the Fire Chief, based on building construction material and features, location, occupancy type, and distance to exposures.

907.2.b Status of existing buildings. In existing buildings without an approved automatic sprinkler system, other than one- or two-family dwelling units, agricultural building not under Special Use permit for commercial purposes where a fire alarm detection system does not exist and the floor area of the building or structure is increased or modified by more than thirty percent (30%) or 1,000 square feet, whichever is less, such building or structure shall

be made to conform to Section 907 when required by the Fire Chief. Buildings with a floor area less than 500 square feet may be exempt, as determined by the Fire Chief, based on building construction materials and features, location, occupancy type, and distance to exposures.

907.2.c Monitoring. All fire alarm detection systems shall be connected directly through and monitored by a U.L. approved central, proprietary or remote station service, which gives audible and visual signals at a constantly attended location. All sprinklered buildings shall be monitored.

907.2.d Type I Hood Installations. The requirement of installation, or replacement, of a Type I Hood System shall require a monitoring fire alarm system to be installed, or for the hood system to be connected to an existing Fire Alarm system for that building.

California Fire Code, Chapter 56 Amendments - Explosives and Fireworks

Section 5601.2 is amended as follows: Permits required.

Section 5601.2 of Chapter 56 of the Fire Code of the Cameron Park Community Service District Fire Department is amended to read as follows:

5601.2 – Permits required. Permits shall be required as set forth in Section 105.6 and regulated in accordance with this section. Where explosives permits are required, they shall be issued by the Fire Chief, or his/her representative, and the El Dorado County Sheriff's Department. Where fireworks permits are required, they shall be issued by the Fire Chief and the El Dorado County Board of Supervisors.

California Fire Code, Chapter 61 Amendments – Liquefied Petroleum Gases

Table 6104.3 Footnote "d" of Chapter 61 of the Fire Code of the Cameron Park Community Service District Fire Department is amended to read as follows:

6104.3 Footnote "d"- ~~500 gallons~~ 251 gallons. Installation of DOT tanks, with setbacks from structures less than 10 feet, must be approved by the Fire AHJ.

Section 6112 is added as follows: High Elevation Liquefied Petroleum Gas Installations (4,000' and Above).

Section 6112 of Chapter 61 of the Fire Code of the Cameron Park Community Service District Fire Department is added to read as follows:

6112.1 Regulators. Two-stage regulator system shall be installed in accordance with manufacturer requirements.

1. Two stage regulator systems shall be installed on all LPG installations.
2. The first stage regulator shall be installed under the hinged gauge cover supplied with the tank. The atmospheric pressure aperture of the regulator shall be pointed downward. The first stage regulator shall be plumbed to the riser of the yard.

- pipng with soft copper tubing to allow flexibility should tank shifting occur. The riser from the yard piping shall be located not more than 3 inches (horizontally) from the walls of the tank.
3. The second stage regulator and riser pipe shall be installed under the eave of the building, as close as practicable to the building wall. This riser shall be securely supported/braced to the wall approximately 10 inches below the regulator so as to prevent bending of the pipe by lateral snow/ice loads.
 4. A protective cover, approved by the gas supplier and Building Official, shall be installed over the second stage regulator and securely supported to the ground or diagonally to the wall.
 5. The riser pipes for the yard piping shall not be imbedded in concrete. Concrete placed around such riser shall be held back at least 1 inch from all sides of the pipe.
 6. At the time of application for any building permit, which involves the installation of a LPG system, the applicant shall submit a LPG system plot plan in 3 copies (or digitally as PDF). The LPG plot plan shall include, but not be limited to, the tank location, proposed tank capacity in U.S. gallons, route of yard piping, location of the riser pipe at the building, property boundaries, an outline of all existing/proposed buildings on the lot and a depiction of the ridge line of any building to be supplied with LPG. This shall also be forwarded to the appropriate fire district to serve as a locator map in event of an emergency.
 7. Location of the centerline of LPG tanks shall be permanently marked by the use of snow stakes, one at each end. Such stakes shall be of sufficient height to be visible through anticipated maximum snow depth at the respective location. Installation and maintenance of these snow stakes is the responsibility of the LPG user.
 8. Propane appliances and accessories shall not be permitted in any new installation below the first floor or below grade, whichever is more restrictive.

Section 6112.2 of Chapter 61 of the Fire Code of the Cameron Park Community Service District Fire Department is added to read as follows:

6112.2 Vertical Riser Piping.

1. Minimum of Schedule 80 - iron piping.
2. Riser shall be within 3 inches horizontally of the tank.
3. Swing joints shall be installed above and below tank level to provide for the tank movement. (Street elbows shall not be used.)
4. A listed flexible riser constructed of copper or stainless steel tubing and protected by a steel covered sheathed material may be used instead of swing joints. The flexible alternative shall provide sufficient slack to allow for tank movement.

Section 6112.4 of Chapter 61 of the Fire Code of the Cameron Park Community Service District Fire Department is added to read as follows:

6112.3 Marking and Locations.

1. An approved sign shall be located directly above the riser shut off valve on the building in a visible location.
2. The liquefied petroleum gas supplier shall affix a weatherproof identification tag to the inside of the tank valve protecting cover. This tag shall contain the supplier's name and emergency telephone number.
3. Tank installation shall be permanently marked by a metal or wood material snow marker, with a minimum dimension of 2 inches by 2 inches. The snow marker shall be of

sufficient height to rise above the annual snow depth and shall be a minimum of 10 feet in height. The snow markers shall be painted yellow and located on opposite ends of the tank.

Section 6113 of Chapter 61 of the Fire Code of the Cameron Park Community Service District Fire Department is added to read as follows:

Section 6113.1 & 6113.2 of Chapter 61 of the Fire Code of the Cameron Park Community Service District Fire Department is added to read as follows:

6113.1 Permits and Plans. Permits shall be required and plans shall be submitted for all underground tank installations and approved by the Fire AHJ.

6113.2 Underground LPG Tank Ownership. Underground LPG tanks shall be prohibited from being sold to end-users and shall be retained by the LPG company under a lease-type system to ensure proper annual maintenance requirements are met and recorded.

Appendix B – Fire Flow Requirements for Buildings

Appendix B is adopted in its entirety, with the following amendments below:

Section B105.1, Table B105.1(1) of Appendix B of the Fire Code of the Cameron Park Community Service District Fire Department is amended to read as follows:

Table B105.1(1) – Required Fire Flow for One- and two- family dwellings, Group R-3 and R-4 buildings and townhouses:

FIRE-FLOW CALCULATION AREA (square feet)	AUTOMATIC SPRINKLER SYSTEM (Design Standard)	MINIMUM FIRE-FLOW (gallons per minute)	FLOW DURATION (hours)
0 – 3,600	No automatic sprinkler system	1,000	1
3,601 and greater	No automatic sprinkler system	Value in Table B105.1(2)	Duration in Table B105.1(2) at the required fire-flow rate (<u>min. 2 hours</u>)
0 – 3,600	Section 903.3.1.3 of the CA Fire Code or Section 313.3 of the CA Residential Code	500 1,000	½ 1

3,601 and greater	Section 903.3.1.3 of the CA Fire Code or Section 313.3 of the CA Residential Code	1/2 value of Table B105.1(2) (min. 1500 GPM)	+ 2
-------------------	---	--	--------

Table B105.2 of Appendix B of the Fire Code of the Cameron Park Community Service District Fire Department is amended to read as follows:

Table B105.2 - Buildings other than one- and two- family dwellings, Group R-3 and R-4 buildings and townhouses:

AUTOMATIC SPRINKLER SYSTEM (Design Standard)	MINIMUM FIRE-FLOW (gallons per minute)	FLOW DURATION (hours)
No automatic sprinkler system	Value in Table B105.1(2)	Duration in Table B105.1(2)
Section 903.3.1.1 of the CA Fire Code	25% 50% of the value in Table B105.1(2) * (min.1500 GPM)	Duration in Table B105.1(2) at the reduced flow rate
Section 903.3.1.2 of the CA Fire Code	25% 50% of the value in Table B105.1(2) *	Duration in Table B105.1(2) at the reduced flow rate

*No footnotes adopted

SECTION 4. ESTABLISHING LIMITS:

That the geographic limits referred to in certain sections of the Fire Code of the Cameron Park Community Service District Fire Department are hereby established as follows:

Sections 5704.2.9.6.1- Geographic limits in which flammable or combustible liquids in above-ground tanks outside of buildings is prohibited:

The limits, referred to in Sections 5704.2.9.6.1 of the Fire Code of the Cameron Park Community Service District Fire Department in which the storage of Class I flammable liquids or Class II combustible liquids in above- ground tanks outside of buildings is restricted, are hereby established as the limits of the Cameron Park Community Service District Fire Department, County of El Dorado.

The storage of Class I flammable liquids or Class II combustible liquids in above-ground tanks outside of buildings is allowed in an AHJ approved Commercial, Industrial Zone with a Special/Conditional Use Permit issued by the County of El Dorado.

Sections 5706.2.4.4 - Geographic limits in which flammable or combustible liquids in above-ground tanks is prohibited:

The limits, referred to in Sections 5706.2.4.4 of the Fire Code of the Cameron Park Community Service District Fire Department in which the storage of Class I flammable liquids or Class II combustible liquids in above- ground tanks is restricted, are hereby established as the limits of the Cameron Park Community Service District Fire Department, County of El Dorado.

The storage of Class I flammable liquids or Class II combustible liquids in above-ground tanks is allowed in an AHJ approved Commercial, Industrial Zone with a Special/Conditional Use Permit issued by the County of El Dorado.

Section 5806.2- Geographic limits in which storage of flammable cryogenic fluids in stationary containers is prohibited:

The limits referred to in Section 5806.2 of the Fire Code of the Cameron Park Community Service District Fire Department in which storage of flammable cryogenic fluids in stationary containers is prohibited are hereby established as the limits of the Cameron Park Community Service District Fire Department, County of El Dorado.

The storage of flammable cryogenic fluids in stationary containers is allowed in an AHJ approved Commercial, Industrial Zone with a Special/Conditional Use Permit issued by the County of El Dorado.

Section 6104.2 - Geographic limits in which storage of liquefied petroleum gases is to be restricted for the protection of heavily populated and congested areas:

The limits, referred to in Section 6104.2 of the California Fire Code, in which storage of liquefied petroleum gas in excess of an aggregate of 2,000-gallon water capacity is restricted, are hereby established as limits of the Cameron Park Community Service District Fire Department, County of El Dorado.

1. The storage of liquefied petroleum gas in excess of an aggregate of 2,000-gallon water capacity when located at least one-half (1/2) mile from property zoned or designated for residential use and at least one-half (1/2) mile from existing residential development with a density greater than one (1) dwelling unit per acre and at least one-half (1/2) mile from any hotel or motel is allowed when AHJ approved and a Special/Conditional Use Permit is issued by the County of El Dorado.
2. Dispensing within established limits. Within the limits established by law restricting the dispersion of liquefied petroleum gas for the protection of heavily populated or congested areas, the aggregate capacity of any one installation shall not exceed a water capacity of 2,000 gallons. The dispensing of liquefied petroleum gas in excess of an aggregate of 2,000-gallon water capacity when located at least one-half (1/2) mile from property zoned or designated for residential use and at least one-half (1/2) mile from existing residential development with a density greater than one (1) dwelling unit per acre and at least one-half (1/2) mile from any hotel or motel is allowed when AHJ approved and a Special/Conditional Use Permit is issued by the County of El Dorado.

SECTION 5: CONFLICT

That Ordinance No. 2016.09.21 of the Cameron Park Community Service District Fire Department, and all other ordinances or parts of ordinances herewith are hereby repealed.

SECTION 6: SEVERABILITY

If any Ordinance, article, subsection or subdivision thereof, provision, sentence, clause or phrase of this code, or any application thereof, is for any reason held to be invalid by a court of competent jurisdiction, such decision shall not affect the remaining provisions of this code, which can be given effect without the invalid portions and, therefore, such invalid portions are declared to be severable. The Cameron Park Community Service District Fire Department hereby declares that it would have enacted this Ordinance and each of its articles, sections, subsections, or subdivisions thereof, provisions, sentences, clauses or phrases irrespective of the fact that one or more of them is declared invalid.

SECTION 7: EFFECTIVE DATE AND PUBLICATION:

This Ordinance shall take effect thirty (30) days after its adoption. The Cameron Park Community Service District Fire Department Board Secretary is directed to publish this ordinance in a newspaper of general circulation in the District. In lieu of publication of the full text of the ordinance, a summary of the ordinance may be published by the by the Board Secretary within fifteen (15) days after its passage and a certified copy shall be posted in the office of the Cameron Park Community Service District Fire Department, pursuant to Government Code Section 36933(c) (1).

The above Ordinance was introduced at a meeting of the Board of Directors of the Cameron Park Community Service District Fire Department on the September 21st 2016 and it was then read for the first time. The Ordinance was read for the second time on the October 19th, 2016 and approved by the following vote:

PASSED AND ADOPTED by the Board of Directors of the Cameron Park Community Service District Fire Department this, 19th day of October, 2016.

AYES:

NOES:

ABSENT:

ABSTAIN:

ATTEST:

Mary Cahill, Board Secretary

ATTEST:

Greg Stanton, Board President

DRAFT

2016 CFC Findings of Fact Matrix

2016 CFC Amended Code Section	Adopted	Adopted as Amended	Finding
111.4		X	Admin
503.2		X	Climatic/Geological/Topographical
503.2.1		X	Climatic/Geological/Topographical
503.2.5		X	Climatic/Geological/Topographical
503.2.6		X	Climatic/Geological/Topographical
503.4.2 through 503.4.5		X	Climatic/Geological/Topographical
507.5.1		X	Climatic/Geological/Topographical
604.1.2		X	Climatic/Geological/Topographical
903.2		X	Climatic/Geological/Topographical
903.2.a		X	Climatic/Geological/Topographical
903.2.b		X	Climatic/Geological/Topographical
903.2.1		X	Climatic/Geological/Topographical
903.2.c		X	Climatic/Geological/Topographical
903.2.3		X	Climatic/Geological/Topographical
903.2.4		X	Climatic/Geological/Topographical
903.2.7		X	Climatic/Geological/Topographical
903.2.9		X	Climatic/Geological/Topographical
903.2.10		X	Climatic/Geological/Topographical
907.2.a		X	Climatic/Geological/Topographical
907.2.b		X	Climatic/Geological/Topographical
907.2.c		X	Climatic/Geological/Topographical
907.2.d		X	Climatic/Geological/Topographical
5601.2		X	Geological/Topographical
Table 6104.3 Footnote "d"		X	Climatic/Geological/Topographical
6112.1		X	Climatic/Geological/Topographical
6112.2		X	Climatic/Geological/Topographical
6112.3		X	Climatic/Geological/Topographical
6113.1		X	Climatic/Geological/Topographical
6113.2		X	Geological/Topographical
Appendix B105.1		X	Climatic/Geological/Topographical
Table B105.1(1)		X	Climatic/Geological/Topographical
B105.2		X	Climatic/Geological/Topographical
Table 105.2		X	Climatic/Geological/Topographical
101.1 through 101.5	X		Admin
102.6 through 102.8	X		Admin
102.10 through 102.12	X		Admin
103.1 through 104.1	X		Admin
104.3 through 104.4	X		Admin
104.6 through 104.6.4	X		Admin
104.8 through 104.9.2	X		Admin
104.10.1 through 104.11.3	X		Admin
105.2.3	X		Admin
105.3.1 through 105.3.2	X		Admin
105.6.10	X		Admin
105.6.17 through 105.6.19	X		Admin
105.6.28	X		Admin

2016 CFC Findings of Fact Matrix

2016 CFC Amended Code Section	Adopted	Adopted as Amended	Finding
105.6.29 through 105.6.37	X		Admin
105.6.39 through 105.6.44	X		Admin
105.7.17 through 105.7.18	X		Admin
106.1	X		Admin
107.1 through 108.3	X		Admin
109.3.2 through 109.4.1	X		Admin
112.1	X		Admin
113.1 through 113.5	X		Admin
113.6	X		Admin
113.6.1	X		Admin
302	X		Admin
303.1 through 303.9	X		Climatic/Geological/Topographical
305.1 through 305.5	X		Climatic/Geological/Topographical
307.1 through 307.5	X		Climatic/Geological/Topographical
308.1 through 308.4.1	X		Climatic/Geological/Topographical
403.1	X		Climatic/Geological/Topographical
403.5 through 403.12	X		Climatic/Geological/Topographical
503	X		Climatic/Geological/Topographical
Appendix D104.1 through D104.3	X		Climatic/Geological/Topographical
D105.1 through D105.4	X		Climatic/Geological/Topographical
D106.1	X		Climatic/Geological/Topographical
D107.1	X		Climatic/Geological/Topographical
D107.2	X		Climatic/Geological/Topographical
Appendix F	X		Climatic/Geological/Topographical
Appendix N	X		Geological/Topographical